

# Smart Elevator Tech, LLC

phone: (415) 819-5744  
 email: sales@smartelevatortech.com  
 web: www.smartelevatortech.com

## Powered Retracta Ladder™

### Order Confirmation

Please complete a form for each different configuration

Date: \_\_\_\_\_ PO#: \_\_\_\_\_ Qty.: \_\_\_\_\_

Company: \_\_\_\_\_

Contact: \_\_\_\_\_

#### #1 Control & Wiring (check one):

Option A: Ladder controlled by elevator controller, via hoistway access key switch. Requires additional controller circuitry, with contacts brought to ladder.

Option B: Ladder controlled by Ladder Access Station #PRL-LKS4 (included with ladder), located within the hoistway.


Option B Interlocked: Ladder Access Station located in lobby, includes an EECO #MV-4CN hatch switch, ladder movement restricted by car placement.

#### #2 Alt. Retractable Ladder Safety Switch


Default switch has (1) N.C. & (1) N.O. contact. Alternate switch has (2) N.C. contacts. Check box if Alt. switch desired - not available for Option A control.

#### #3 Pit Depth

Fill in dimension box (in inches) on detail to the right.

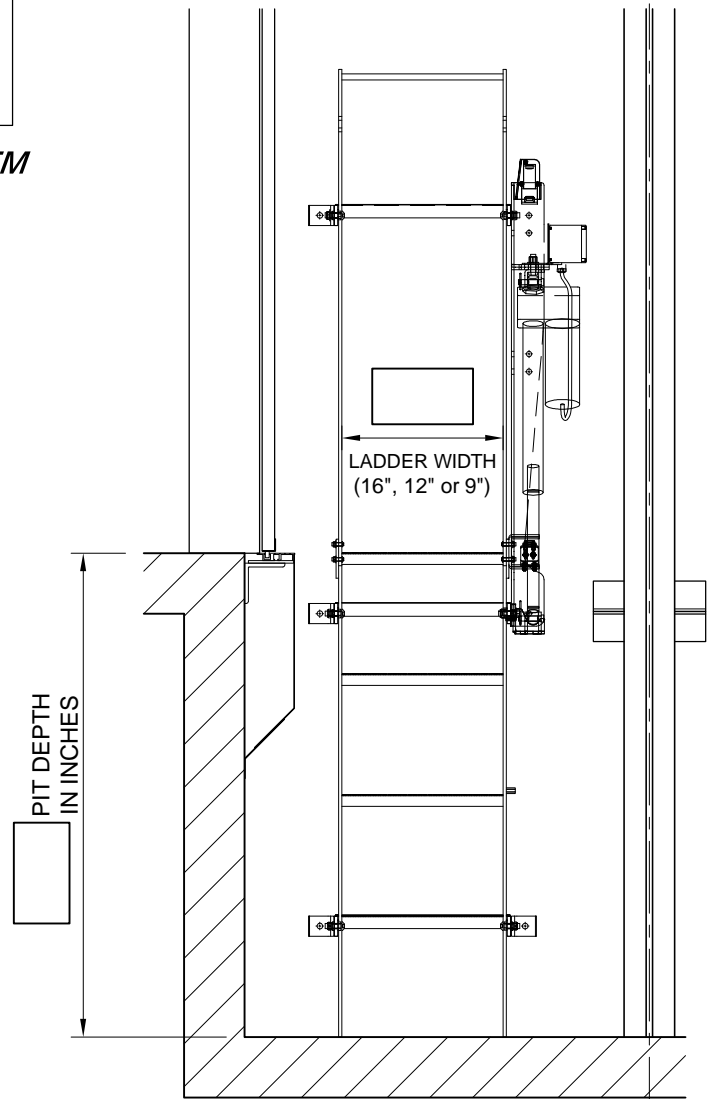

L.H. Orientation Shown

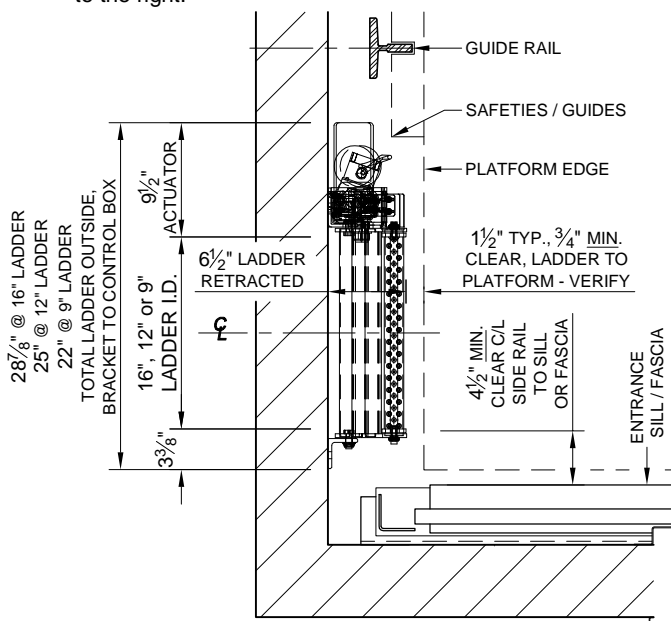

L.H. Powered Retracta Ladder

#### #4 Ladder Width


Fill in dimension box (in inches) on detail above. Standard options are: 16", 12" or 9".

#### #5 Verify Clearances

& fit per dimensions shown. L.H. & R.H. are symmetrically opposite.

#### #6 Ladder Orientation

Check a box below to select a L.H. or R.H. ladder as shown per the details.

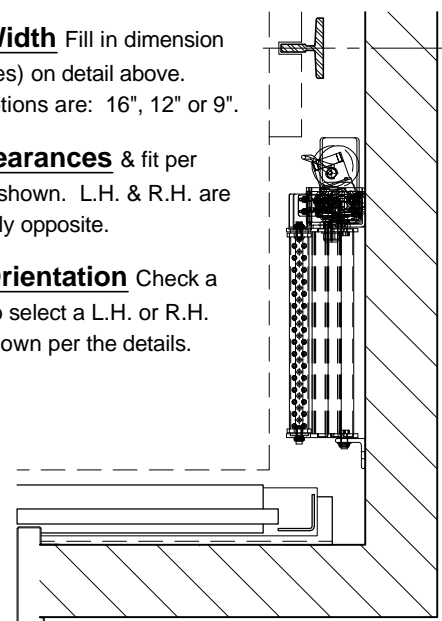

R.H. Powered Retracta Ladder